

Bulletin

Roof Testing Laboratory



Roof System Dynamic Wind Uplift Resistance Results

File Numbers:	SOP1-020-059-015 SOP1-200939-01-5000
Test Dates:	2011-04-15 / 2011-06-04
Publication Date:	2012-02-01
Revision Dates:	2015-06-23 (R1) 2017-05-15 (R2)
Reappraisal Date:	2020-05-15



MOD-BIT XPRESS ISO COLD APPLIED SYSTEM (AARS) ADHESIVE APPLIED ROOFING SYSTEM

Roofing System Summary

Cap sheet membrane:	Modified bitumen membrane / Torch applied
Base sheet membrane:	N/A
Cover board:	N/A
Insulation:	Composite board consisting of a bitumen membrane, a mineral wool board and an insulation board 914 x 4877 x 66 mm (3' x 16' x 2 ^{19/32} ") / Adhered with Duotack
Vapour barrier:	Self-adhesive membrane
Thermal barrier:	Optional
Decking:	Steel deck

Dynamic Uplift Resistance (DUR) as per CSA A123.21

System Designation	Measured Value	Computed Value (To Include 1.5 Experimental Factor)
A	-3,6 kPa (-75 psf)	-2,4 kPa (-50 psf)
B	-3,6 kPa (-75 psf)	-2,4 kPa (-50 psf)

Roof Testing Laboratory



Roof System Dynamic Wind Uplift Resistance Results

SOP1-020-059-015 / SOP1-200939-01-5000

Products

CAP SHEET MEMBRANE				
TESTED PRODUCT : Membrane composed of a non-woven polyester reinforcement and SBS modified bitumen				
System	Application Method			
A, B	Torch applied			
ELIGIBLE PRODUCT(S)				
Soprema	Sopralene Flam 250 GR	Sopralene Flam 180 GR	Soprastar Flam HD GR	Sopralene Flam 180 FR GR
	Sopralene Flam 250 FR GR	Soprastar Flam HD FR GR	Sopralene Mammouth GR	Sopraply Traffic Cap 560
	Sopraply Traffic Cap FR 561			

BASE SHEET MEMBRANE
TESTED PRODUCT : N/A

COVER BOARD
TESTED PRODUCT : N/A


Roof Testing Laboratory



Roof System Dynamic Wind Uplift Resistance Results

SOP1-020-059-015 / SOP1-200939-01-5000

INSULATION (Top Row)		
TESTED PRODUCT : Composite board composed of SBS modified bitumen membrane factory-laminated on a rigid mineral wool board and a polyisocyanurate insulation board		
System	Application Method	Fastening Rate
A, B	Adhered with Duotack	Ribbons at 305 mm (12 in) (see patterns)
ELIGIBLE THICKNESS(ES)		
Between 51 to 127 mm (2 to 5 in)		
FASTENING METHOD		
Duotack adhesive		
FASTENING PATTERN		
<p>System A</p> <p>Diagram showing the fastening pattern for System A. The total width is 2,440m and the height is 0,914m. The pattern consists of four vertical fastening ribbons. The spacing between the ribbons is 0,305m. The left margin is 0,152m and the right margin is 0,153m. The ribbons are 0,076m wide.</p>		

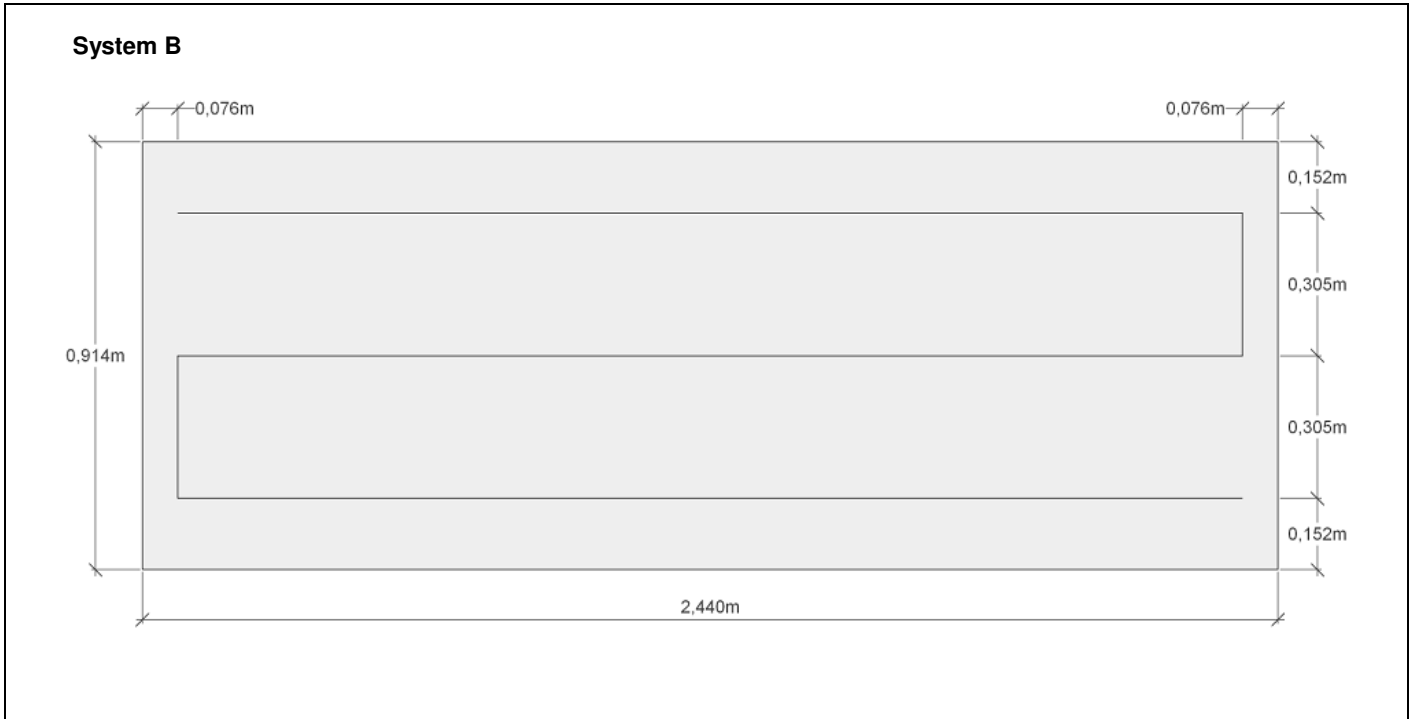

ELIGIBLE PRODUCT(S)				
Soprema	Xpress ISO			

INSULATION (Bottom Row)
TESTED PRODUCT : N/A

FASTENERS PULL OUT RESISTANCE
TESTED PRODUCT(S) : N/A

Roof Testing Laboratory



Roof System Dynamic Wind Uplift Resistance Results

SOP1-020-059-015 / SOP1-200939-01-5000

ADHESIVE				
TESTED PRODUCT : Low-rise, two-component, polyurethane adhesive				
System	Ribbon's spacing		Primer	
A, B	305 mm (12 in)		N/A	
ELIGIBLE PRODUCT(S)				
Soprema	Duotack			

VAPOUR BARRIER				
TESTED PRODUCT : Self-adhesive membrane composed of a trilaminated woven polyethylene and SBS modified bitumen				
System	Fastening Method		Primer	
A, B	Self-adhered		N/A	
ELIGIBLE PRODUCT(S)				
Soprema	Sopravap'R			
Attachment method: Self-adhered (Steel deck excepted, all substrates must be primed with Elastocol Stick or Elastocol Stick Zero.)				
Soprema	Elastophene SP 2.2	Sopralene 180 SP 3.5		
Attachment method: Torch applied (All substrates must be primed with Elastocol 500.)				

THERMAL BARRIER				
TESTED PRODUCT : Optional				
ELIGIBLE THICKNESS(ES)				
Between 6,4 to 15,9 mm (¼ to ⅝ in)				
ELIGIBLE PRODUCT(S)				
CGC / USG	Securock			
Unifix	PermaBase Dek			

Roof Testing Laboratory



Roof System Dynamic Wind Uplift Resistance Results

SOP1-020-059-015 / SOP1-200939-01-5000

General Notes

1. Decking:

The tests performed by **exp** services inc. («**exp**») were performed over a standard roll formed steel deck profile, with a galvanized or aluminum / zinc alloy coating finished, as per ASTM A653, A792, A1008 or CSSBI 10M standards, bearing a thickness of 0.76 mm (0.03 inch) minimum (commonly defined as 22 gauge), corresponding to the ASTM A653M grade SS 230, having a yield point of 230 MPa (33 ksi) and a tensile strength of 310 MPa (45 Ksi).

Equivalency; tests have demonstrated that the self-adhered vapour retarder in the system herein described is suitable for application over properly prepared concrete deck primed with Elastocol Stick or Elastocol Stick Zero.

Equivalency; tests have demonstrated that the heat welded vapour barrier in the system herein described is suitable for application on concrete deck properly primed with Elastocol 500.

Tests could be conducted on 4 'x 8' x 5/8" standard plywood deck to assess eligibility for possible equivalencies.

The deck's fastening to the supporting structure must be strong enough to resist wind uplift loads (as defined per NBC requirements).

2. Deck equivalency products:

18 to 22 gage steel deck. Wood or concrete deck which testing gave equivalent or superior uplift resistance than the value specified in the "Fasteners Pull Out Resistance" section.

3. Fasteners Pull Out Resistance:

Testing were conducted in laboratory according to ANSI/SPRI FX-1 2011 standard, over a minimum of 10 test samples on a **Com-Ten** apparatus over steel deck (unless stated otherwise).

4. Adhesive Pull Resistance:

Testing were conducted in laboratory over 3 test samples, according to ANSI/SPRI IA-1 2010 standard on a **Com-Ten** apparatus over steel deck (unless stated otherwise) or, according to ASTM D1623 standard over a universal press testing bench, for in-between materials.

5. Note on adhesive:

Follow all guide lines or supplementary instructions from the manufacturer regarding adhesive application.

6. Equivalent products:

Only the products listed in this report under eligible products are deemed acceptable as substitute to the tested products. Any other modifications must be requested in written, on **exp** application form, to be studied for approval.

7. Optional components:

Any components of this roofing system listed as optional, may be removed from the roof design. Inclusion or exclusion of the said component having no effect on the published dynamic uplift resistance results. (DUR).

8. Experimental factor:

In accordance with CSA A123.21 standard, the published dynamic uplift resistance (DUR) include a computed experimental factor of 1,5.

Roof Testing Laboratory



Roof System Dynamic Wind Uplift Resistance Results

SOP1-020-059-015 / SOP1-200939-01-5000

9. Building Wind Load Calculation:

An online calculator is available at <http://www.exp.com/fr/rooftesting>.

The calculator will compute, the Wind Load of any given building, for field, perimeter and corners, as per 2015 CNB requirement, without experimental factor. It will also compute perimeter's and corner's zone dimensions.

10. Technical Advisories:

This roof system assessment reports must be read in conjunction with any issued technical advisories from **exp**.

11. Notice :

Exp reserves the right to withdraw, without prior notice, any Bulletin of Roof System Dynamic Wind Uplift Resistance Results published and/or make any necessary corrections.

12. Version tracking table:

2012-02-01	First edition
2015-06-23 (R1)	N/D
2017-05-15 (R2)	New presentation layout

Prepared by:

exp Services Inc

Serge Rochon, P.Eng.
Provincial Director – Roofing & Building Envelope
OIQ N° 114865

May 15th 2017

Date