

Bulletin

Roof Testing Laboratory



Roof System Dynamic Wind Uplift Resistance Results

File Numbers:	SOPI-019-059-200
	SOPI-019-059-300
	SOPI-019-059-400
Test Dates:	2008-12-09 / 2008-12-11 / 2008-12-17
Publication Date:	2010-07-28
Revision Dates:	2015-04-30 (R1) 2017-05-15 (R2) 2018-07-03 (R3)
Reappraisal Date:	2021-07-03



MOD-BIT SOPRABASE FR 180 SYSTEM **(MARS) MECHANICALLY ATTACHED ROOFING SYSTEM**

Roofing System Summary

Cap sheet membrane:	Modified bitumen membrane / Torch applied
Base sheet membrane:	N/A
Cover board:	Board composed of a SBS modified bitumen laminated on a wood fiber board 914 x 2591 x 12,7 mm (3' x 8,5' x 1/2") / Mechanically fastened
Insulation:	Rigid polyisocyanurate foam insulation board 1220 x 1220 x 38 mm (4' x 4' x 1 1/2") / Loose laid
Vapor barrier:	Self-adhering membrane
Thermal barrier:	Optional
Decking:	Steel deck

Dynamic Uplift Resistance (DUR) as per CSA A123.21

System Designation	Measured Value	Computed Value (To include 1.5 Experimental Factor)
A	-3,6 kPa (-75 psf)	-2,4 kPa (-50 psf)
B	-5,0 kPa (-105 psf)	-3,4 kPa (-70 psf)
C	-7,8 kPa (-162 psf)	-5,2 kPa (-108 psf)

Roof Testing Laboratory



Roof System Dynamic Wind Uplift Resistance Results

SOPI-019-059-200 / SOPI-019-059-300 /SOPI-019-059-400

Products

CAP SHEET MEMBRANE				
TESTED PRODUCT : Membrane composed of SBS modified bitumen and a glass mat reinforcement				
System	Application Method			
A - B - C	Torch applied			
ELIGIBLE PRODUCT(S)				
Soprema	Soprafix Cap 650	Sopralene Flam 180 GR	Sopralene Flam 250 GR	Soprapstar Flam HD GR
	Sopralene Flam 180 FR GR	Sopralene Flam 250 FR GR	Soprapstar Flam HD FR GR	Sopralene Mammouth GR
	Sopraply Traffic Cap 660	Sopraply Traffic Cap FR 661	Sopraply Traffic Cap 560	Sopraply Traffic Cap FR 561
BASE SHEET MEMBRANE				
TESTED PRODUCT : N/A				

Roof Testing Laboratory



Roof System Dynamic Wind Uplift Resistance Results

SOPI-019-059-200 / SOPI-019-059-300 /SOPI-019-059-400

COVER BOARD		
TESTED PRODUCT : Board composed of a SBS modified bitumen membrane with a non-woven polyester reinforcement, factory-laminated on an high-strenght wood fiber board		
System	Application Method	Fastening Rate
A	Mechanically fastened	Fastener row spacing : 406 mm (16 in) o.c. Fastener spacing : 610 mm (24 in) o.c.
B	Mechanically fastened	Fastener row spacing : 406 mm (16 in) o.c. Fastener spacing : 457 mm (18 in) o.c.
C	Mechanically fastened	Fastener row spacing : 406 mm (16 in) o.c. Fastener spacing : 305 mm (12 in) o.c.
ELIGIBLE THICKNESS(ES)		
14,9 mm (19/32 in)		
FASTENING METHOD		
Screws and plates		
FASTENING PATTERN		
<p>System A</p>		


Roof Testing Laboratory




Roof System Dynamic Wind Uplift Resistance Results

SOPI-019-059-200 / SOPI-019-059-300 / SOPI-019-059-400

System B

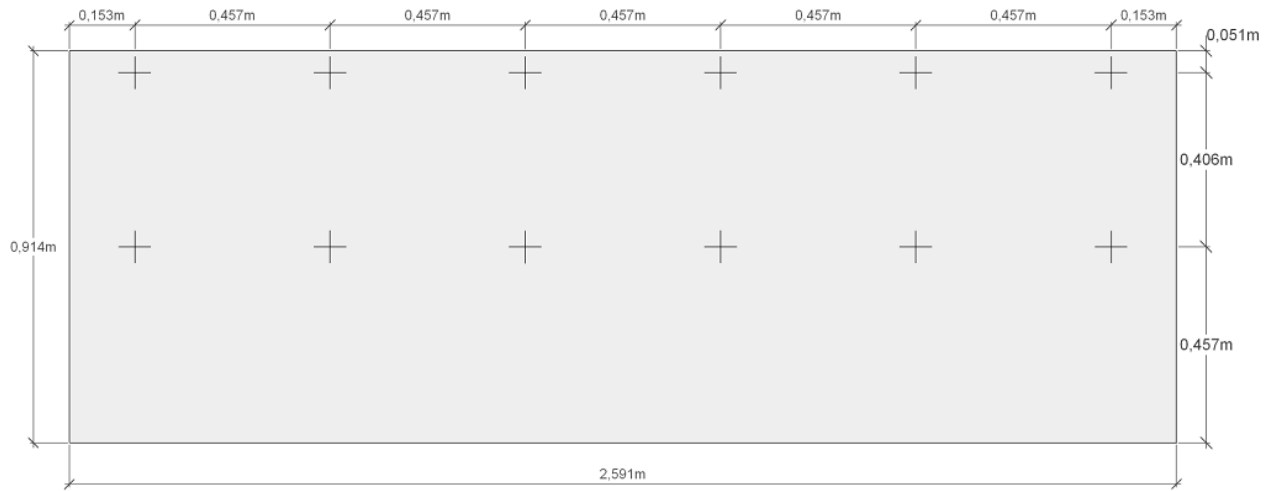

System C

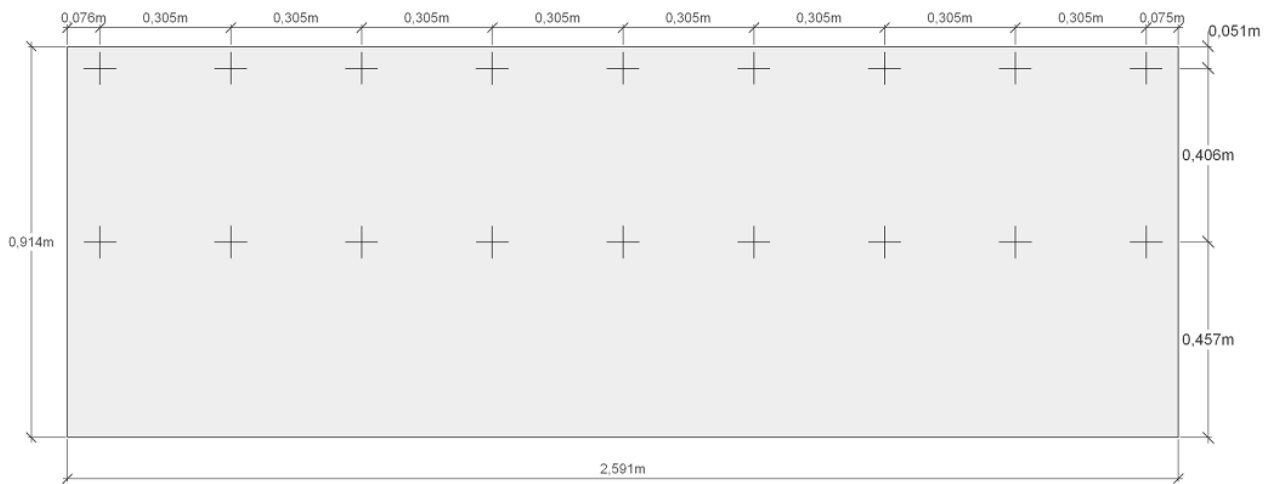

ELIGIBLE PRODUCT(S)

Soprema	Soprabase FR 180	Soprabase HD		
---------	------------------	--------------	--	--

Roof Testing Laboratory



Roof System Dynamic Wind Uplift Resistance Results

SOPI-019-059-200 / SOPI-019-059-300 /SOPI-019-059-400

INSULATION (Top Row)				
TESTED PRODUCT : Rigid insulation board composed of a closed cell polyisocyanurate foam core bonded in the foaming process between two organic glass fiber reinforced felt				
System	Application Method		Fastening Rate	
A - B - C	Loose laid		N/A	
ELIGIBLE THICKNESS(ES)				
Between 38 to 102 mm (1 ½ in to 4 in)				
ELIGIBLE PRODUCT(S)				
Johns Manville	ENRGY 3	ENRGY 3 CGF		
Soprema	Sopra-ISO	Sopra-ISO Plus	SopraRock MD	SopraRock MD Plus
	SopraRock DD	SopraRock DD Plus		
Atlas Roofing Corp.	ACFoam II	ACFoam III	ACFoam IV	
Hunter Panels	H-Shield	H-Shield CG		

INSULATION (Bottom Row)	
TESTED PRODUCT : N/A	

FASTENERS PULL OUT RESISTANCE		
TESTED PRODUCT(S) : Hardened carbon #14 fasteners with anticorrosion coating		
System	Screws	Plates
A - B - C	#14 x 102 mm (4 in)	Round plates of 51 mm (2 in)
FASTENERS MEASURED PULL OUT RESISTANCE		
238 kgf (524 lbf)		
ELIGIBLE PRODUCT(S)		
Soprema	Soprafix	

ADHESIVE	
TESTED PRODUCT : N/A	

Roof Testing Laboratory



Roof System Dynamic Wind Uplift Resistance Results

SOPI-019-059-200 / SOPI-019-059-300 /SOPI-019-059-400

VAPOR BARRIER				
TESTED PRODUCT : Self-adhesive membrane composed of a trilaminated woven polyethylene and SBS modified bitumen				
System	Fastening Method		Primer	
A - B - C	Self-adhered		N/A	
ELIGIBLE PRODUCT(S)				
Soprema	Sopravap'R	Sopralene Stick Adhesive		
Attachment mode : Adhered (steel deck excepted, all substrates must be primed with Elastocol Stick or Elastocol Stick Zero)				
Soprema	Sopralene 180 SP 3.5 mm	Elastophene SP 2.2 mm		
Attachment mode : Torch applied (All substrates must be primed with Elastocol 500)				
Soprema	Soprastop	Xpress Vap'R Board		
Attachment mode : Loose laid, adhered, or mechanically fastened				
ELIGIBLE PRODUCT(S) over thermal barrier : N/A				

THERMAL BARRIER				
TESTED PRODUCT : Optional				
ELIGIBLE THICKNESS(ES)				
Between 6,4 to 19,5 mm (¼ to ¾ in)				
ELIGIBLE PRODUCT(S)				
Georgia-Pacific	DensDeck	DensDeck Prime		
CGC / USG	Securock Gypsum Fiber Roof Board			
Unifix	PermaBase Dek			

Roof Testing Laboratory



Roof System Dynamic Wind Uplift Resistance Results

SOPI-019-059-200 / SOPI-019-059-300 /SOPI-019-059-400

General Notes

1. Decking:

Tests were performed over a standard roll formed steel deck profile, with a galvanized or aluminum / zinc alloy coating finished, as per ASTM A653, A792, A1008 or CSSBI 10M standards, bearing a thickness of 0.76 mm (0.03 inch) minimum (commonly defined as 22 gauge), corresponding to the ASTM A653M grade SS 230, having a yield point of 230 MPa (33 ksi) and a tensile strength of 310 MPa (45 Ksi). The tests could also be performed on concrete deck or standard 4' x 8' x 5/8" plywood deck.

The deck's fastening to the supporting structure must be strong enough to resist wind uplift loads (as defined per NBC requirements).

2. Deck equivalency products:

18 to 22 gage steel deck. Wood or concrete deck which testing gave equivalent or superior uplift resistance than the value specified in the "Fasteners Pull Out Resistance" section.

3. Fasteners Pull Out Resistance:

Testing were conducted in laboratory according to ANSI/SPRI FX-1 2011 standard, over a minimum of 10 test samples on a **Com-Ten** apparatus over steel deck (unless stated otherwise).

4. Adhesive Pull Resistance:

Testing were conducted in laboratory over 3 test samples, according to ANSI/SPRI IA-1 2010 standard on a **Com-Ten** apparatus over steel deck (unless stated otherwise) or, according to ASTM D1623 standard over a universal press testing bench, for in-between materials.

5. Note on adhesive:

Follow all guide lines or supplementary instructions from the manufacturer regarding adhesive application.

6. Equivalent products:

Only the products listed in this report under eligible products are deemed acceptable as substitute to the tested products. Any other modifications must be requested in written, on **EXP** application form, to be studied for approval.

7. Optional components:

Any components of this roofing system listed as optional, may be removed from the roof design. Inclusion or exclusion of the said component having no effect on the published dynamic uplift resistance results. (DUR).

8. Experimental factor:

In accordance with CSA A123.21 standard, the published dynamic uplift resistance (DUR) include a computed experimental factor of 1,5.

9. Building Wind Load Calculation:

An online calculator is available at <http://www.exp.com/fr/rooftesting>.

The calculator will compute, the Wind Load of any given building, for field, perimeter and corners, as per 2015 CNB requirement, without experimental factor. It will also compute perimeter's and corner's zone dimensions.

Roof Testing Laboratory



Roof System Dynamic Wind Uplift Resistance Results

SOPI-019-059-200 / SOPI-019-059-300 /SOPI-019-059-400

10. Technical Advisories:

This roof system assessment reports must be read in conjunction with any issued technical advisories from **EXP**.

11. Notice

Exp reserves the right to withdraw, without prior notice, any Bulletin of Roof System Dynamic Wind Uplift Resistance Results published and/or make any necessary corrections.

12. Version tracking table :

2010-07-28	First edition
2015-04-30 (R1)	N/D
2017-05-15 (R2)	New presentation layout, adjustment to fastening patterns
2018-07-03 (R3)	Addition of a cover board material

Prepared by:

EXP Services Inc.

Serge Rochon, P.Eng.
Provincial Director – Roofing & Building Envelope
OIQ N° 114865

July 3rd 2018

Date